

Alfa Laval SB Tank Pressure Regulator

Regulating valves

Introduction

The Alfa Laval SB Tank Pressure Regulator maintains the working pressure in the vapour space, or at the top, of a process tank during filling, processing and emptying. It generally connects directly to the gas pipe or Cleaning-in-Place (CIP) pipe that leads in to the tank top, or is incorporated into a flow panel. This ensures process safety and effectiveness as well as safeguards product integrity.

Application

This control valve typically regulates the pressure in tanks used in the dairy, food, beverage, brewery and many other industries. The valve easily integrates with an Alfa Laval SCANDI BREW® tank top system.

Benefits

- Reliable, constant tank pressure control
- Variable pressure setting
- Optimized cleaning
- Built-in pressure gauge
- Fully cleanable with Cleaning-in-Place system

Standard design

The pressure regulator comprises a single valve unit including pressure exhaust valve, pressure supply valve and connection for pressure gauge. On top is a vent port with outlet connection. A tank connection at the side branch is normally connected to the pipe leading to the tank top. It is also possible to incorporate the pressure regulator in a flow panel.

Working principle

The valve unit has a variable setting, which enables adjustment of the relieving pressure to match the required working pressure in the tank. When tank top pressure exceeds the preset pressure, the regulator releases gas through the vent port—either for atmospheric discharge or for collection. If the tank top pressure decreases, a gas supply connection at the bottom of the valve allows gas to flow into the tank.



TECHNICAL DATA

Nominal size	Pressurerange	Max. Filling/emptying speed	Working capacity of fermentation ¹
1"	0.2-4.0 bar	25 m ³ /h	100 m ³
1½"	0.2-4.0 bar	50 m ³ /h	200 m ³
2"	0.2-4.0 bar	100 m ³ /h	400 m ³
3"	0.2-4.0 bar	200 m ³ /h	800 m ³

¹ At max. fermentation rate 2.4 deg. Plato / 24 hrs.

PHYSICAL DATA

Materials

Product wetted steel parts:	EN 1.4307 (AISI 304L)
Product wetted seals:	EPDM

Connections

Connections
Union IDF acc. ISO 2853
Union SMS Swedish Standard Union
lamp ferrule acc. ISO 2852

Cleaning in place (CIP)

Cleaning of the Tank Pressure Regulator is necessary before the next batch. The Tank Pressure Regulator is incorporated in the tank CIP procedure by means of the CIP adaptor. Before cleaning, the CIP adaptor is mounted on the pressure regulator whereby gas supply valve and pressure relief valve are forced open and fully cleaned in bypass. During the CIP procedure, all functions are blocked. See schematic drawing of the regulator.

Options

Pos. 1: CIP bend


Pos. 2: CIP T-piece

Pos. 3: Protection valve for pressure gauge

Pos. 4: Pressure gauge

Mounting bracket

Dimensions (mm)

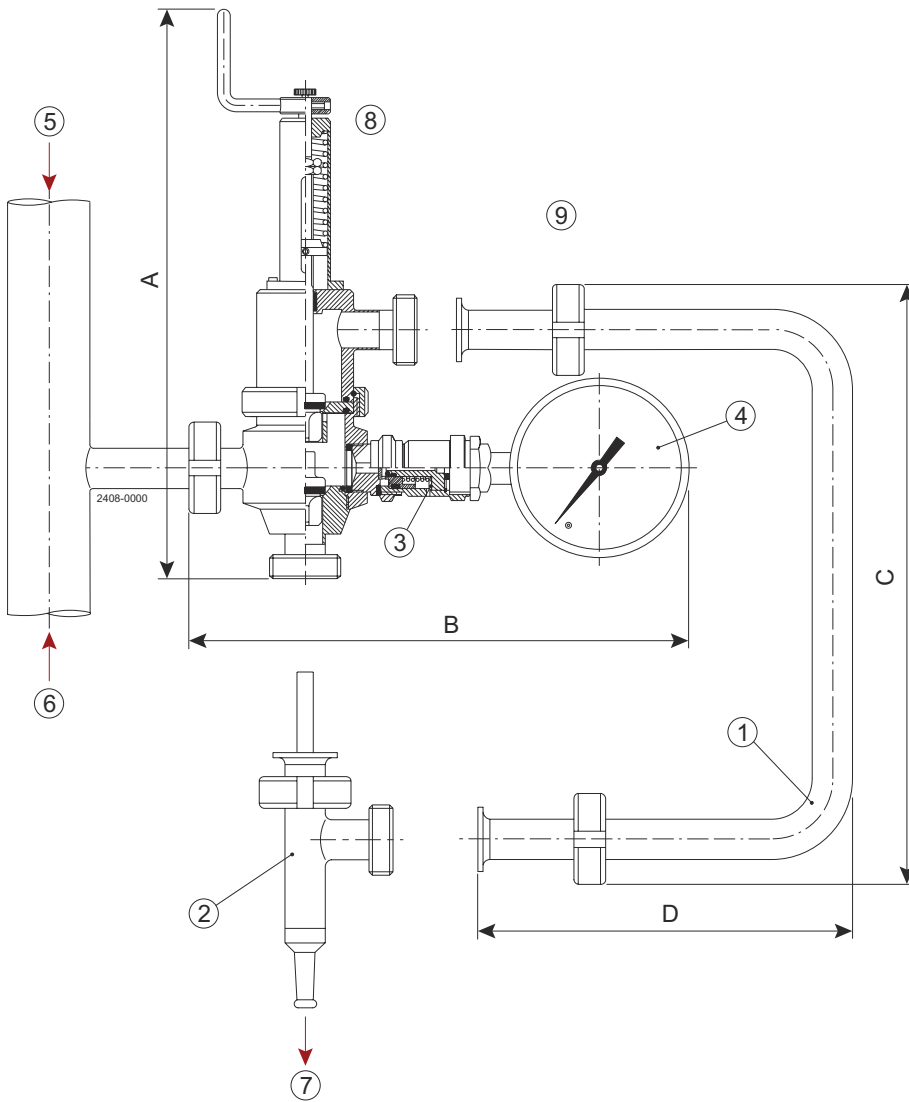

- 5 - CO₂
- 6 - CIP pipe to tank top
- 7 - CIP
- 8 - Variable pressure setting
- 9 - Pressure regulator with CIP adapter

Size	A	B
25	390	345
38	440	390
51	540	390
76.1	620	380

Size	Connection	C	D
25	DIN	305	215
40	DIN	355	220
50	DIN	435	230
80	DIN	500	230

25	SMS	290	205
38	SMS	355	210
51	SMS	425	215
76.1	SMS	480	215

25	Clamp	345	220
38	Clamp	385	225
51	Clamp	460	230
76.1	Clamp	500	230

25	IDF	300	210
----	-----	-----	-----

Size	Connection	C	D
38	IDF	355	215
51	IDF	430	220
76.1	IDF	475	220

This document and its contents are subject to copyrights and other intellectual property rights owned by Alfa Laval Corporate AB. No part of this document may be copied, re-produced or transmitted in any form or by any means, or for any purpose, without Alfa Laval Corporate AB's prior express written permission. Information and services provided in this document are made as a benefit and service to the user, and no representations or warranties are made about the accuracy or suitability of this information and these services for any purpose. All rights are reserved.

200003959-1-EN-GB

© Alfa Laval Corporate AB

How to contact Alfa Laval

Up-to-date Alfa Laval contact details for all countries are always available on our website at www.alfalaval.com